



CROSS SECTION

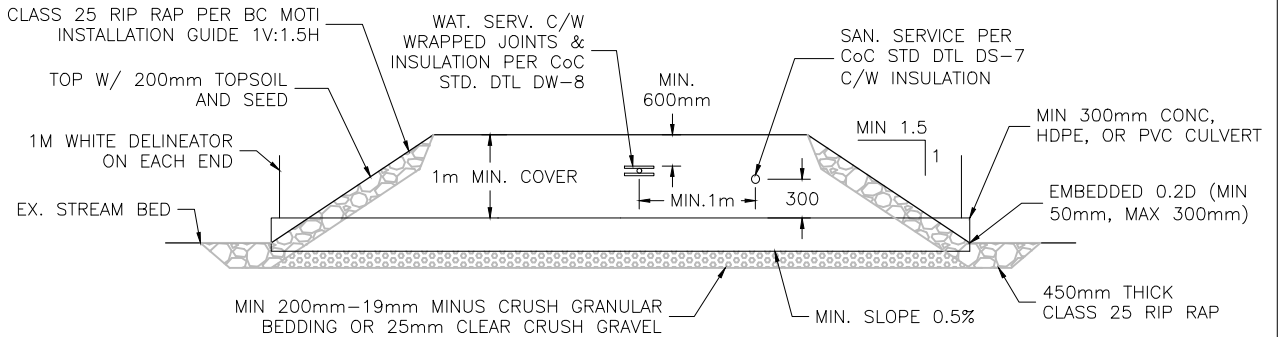

PROFILE

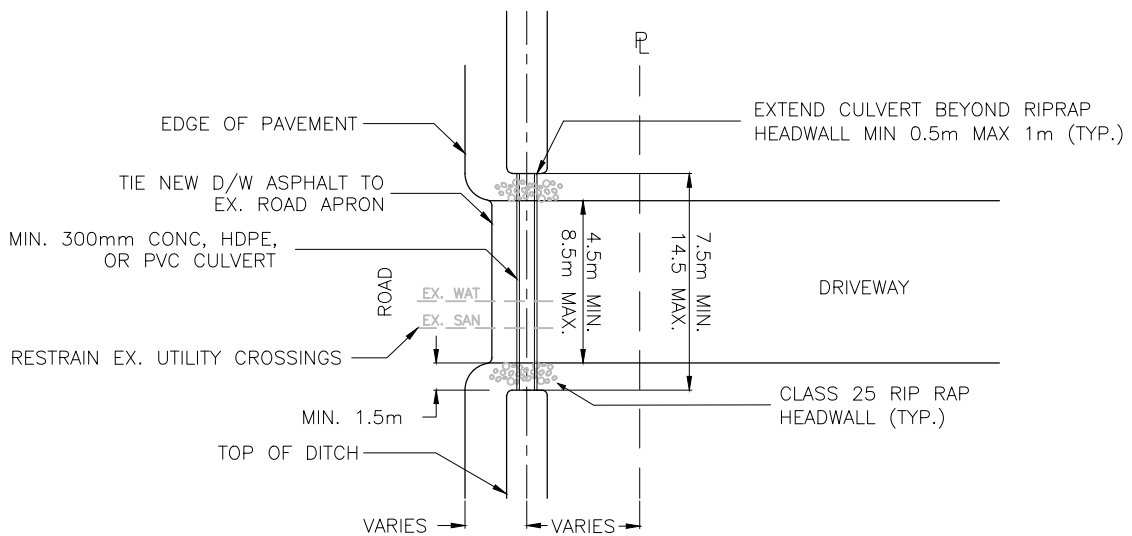

PLAN

NOTES:

1. CULVERT SIZE TO BE DETERMINED BY ENGINEER OR PROVIDED BY CITY. ACCEPTED MATERIALS INCLUDE HDPE, CONCRETE, OR PVC. MIN DEPTH OF COVER AS PER MANUFACTURERS SPEC'S.
2. SPIGOT END OF PIPE (WHERE APPLICABLE) TO FACE DOWNSTREAM AND TO BE CLEAR OF ENDWALLS. HILLSIDE CULVERTS TO HAVE ENERGY DISSIPATION AND EROSION PROVISIONS.
3. RIP RAP HEADWALLS TO BE COVERED IN MIN 200MM TOPSOIL AND SEED. HEADWALLS MAY ALSO BE LOCKBLOCK, CONCRETE, MSE WALL, OR OTHER AS APPROVED BY CITY.
4. REFER TO CONTRACT DRAWINGS FOR SITE SPECIFIC DIMENSIONS, THE LAND DEVELOPMENT BYLAW 2024 No. 3055 AND MMCD SECTION 31 23 01, 31 37 10, 33 42 13 FOR DETAILED SPECIFICATIONS.
5. WATER AND SEWER SERVICES TO BE COORDINATED WITH CITY UTILITIES DEPT. CONTRACTOR MUST COMPLETE BC-1-CALL BEFORE EXCAVATION

DRIVEWAY CULVERT



REVISED: 01/24 APPROVED: DM

APPROVED: DWG. NO.

DATE: 10/2023 **DD-6**

DRAWN: KKB